


INITIAL	ISSUE	DATE
DCB	8:01	14-3-00

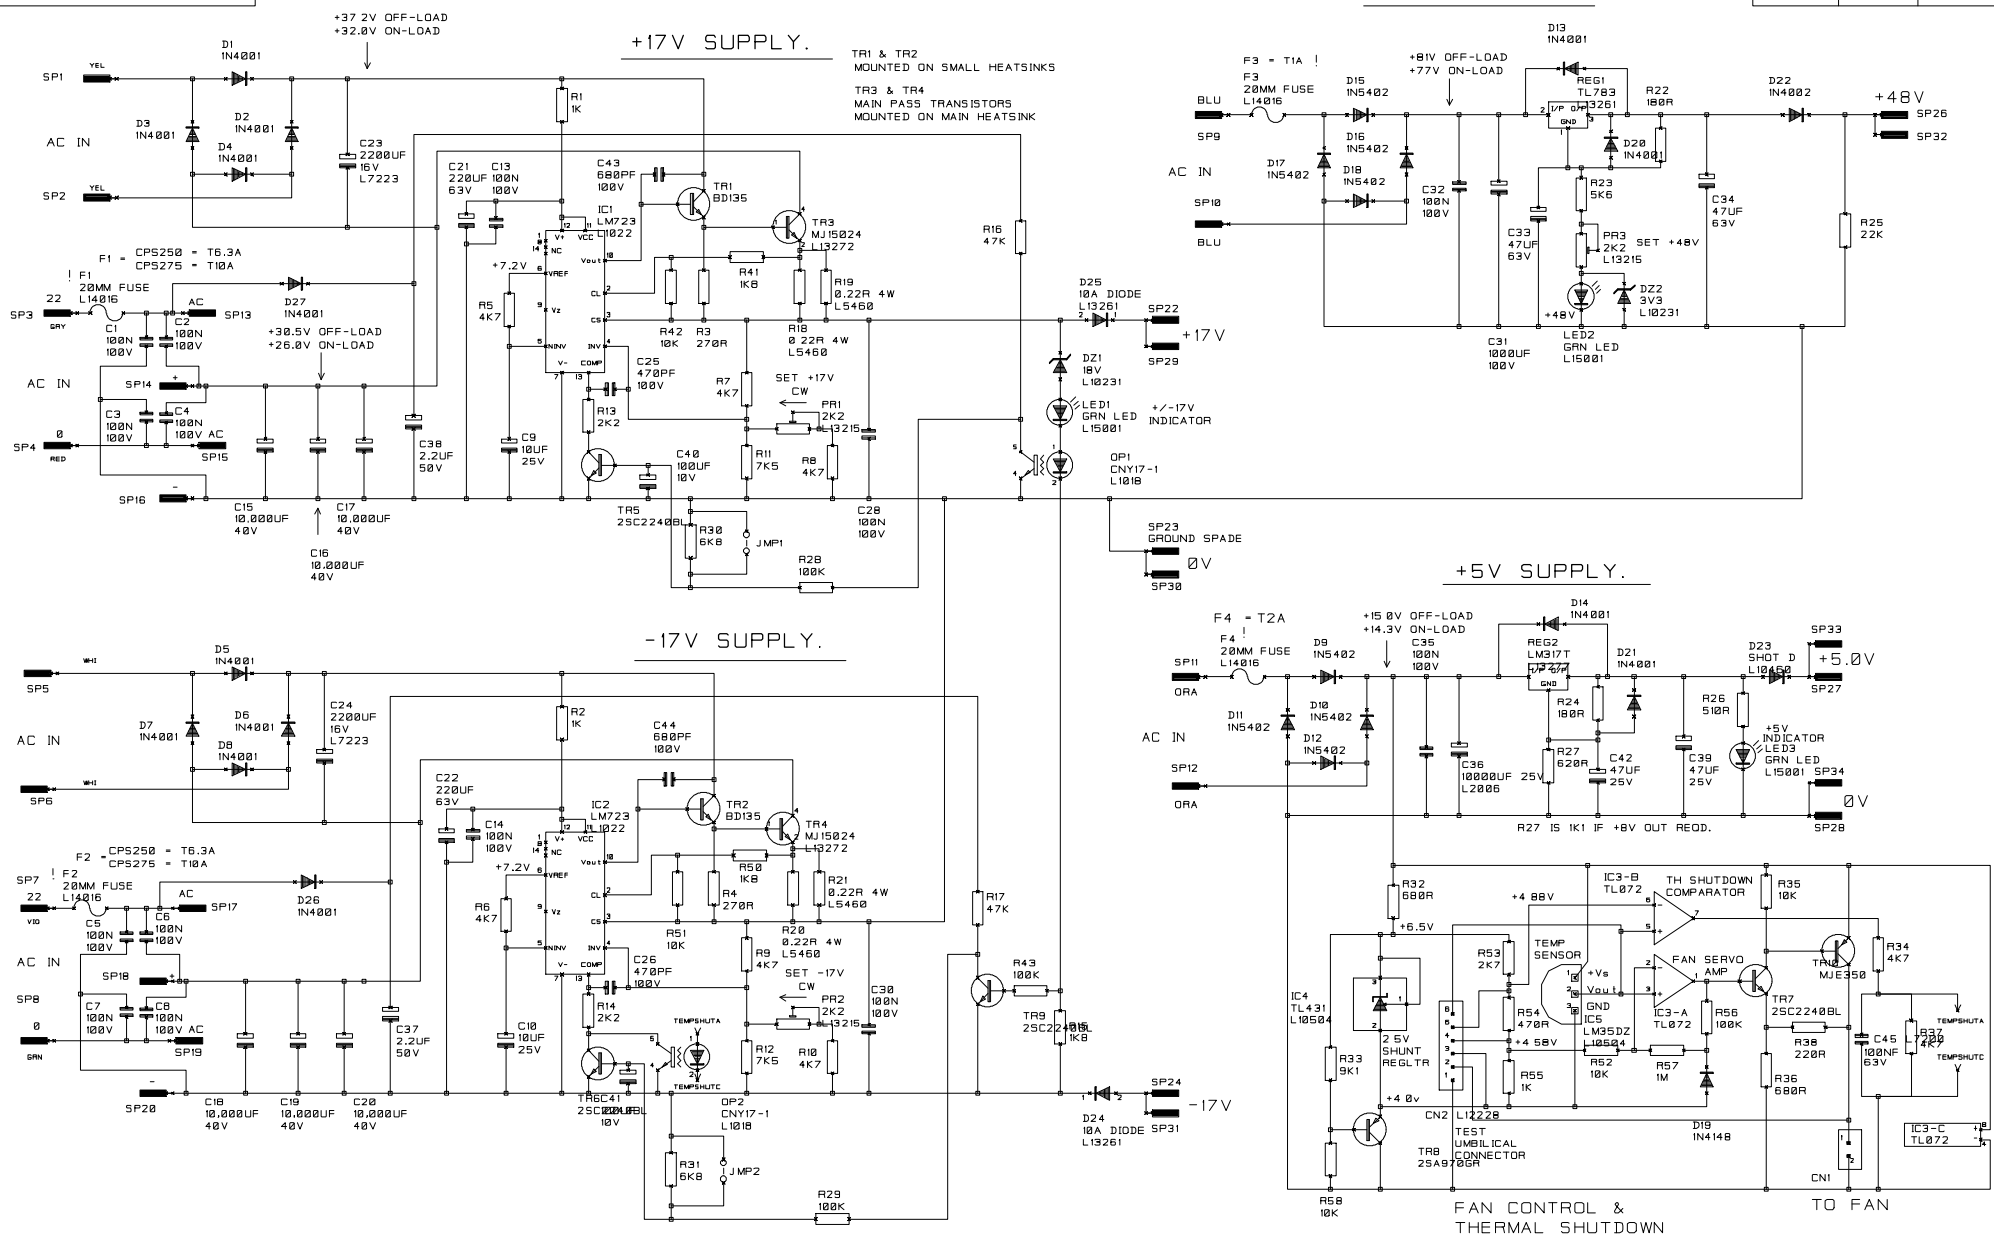

NOTES

UNREGULATED VOLTAGES SHOWN
FOR NOMINAL MAINS INPUT,
BOTH OFF-LOAD & ON FULL LOAD

REMOVED. R25,39,40,46-49. C29 DZ3.4

TEST CONNECTOR

- 6 TEMP SENSOR
- 5 SET SHUTDOWN
- 4 SET FAN START
- 3 +4V RAIL
- 2 FAN VOLTS
- 1 0V

DRN

DRGS

TITLE CPS250/275
POWER SUPPLY
PCB

DRG NO.

ED 3803